

2025 ANNUAL PERFORMANCE REPORT

PORT MCNICOLL
WASTEWATER
TREATMENT PLANT

For the period of
January 1st, 2025 to December 31st, 2025

Prepared for the Corporation of the Township of Tay by the Ontario Clean Water Agency



REQUIREMENTS FOR ANNUAL PERFORMANCE REPORT

This annual performance report is prepared in accordance with Amended Environmental Compliance Approval No. 8421-9PMHXN Section 10.(5) items a) through l) for the for the Port McNicoll Wastewater Treatment Plant.

10. REPORTING

(5) The Owner shall prepare and submit a performance report to the Water Supervisor on an annual basis, within ninety (90) days following the end of the period being reported upon. The reports shall contain, but shall not be limited to, the following information:

(a) a summary and interpretation of all monitoring data and a comparison to the effluent limits outlined in Condition 6, including an overview of the success and adequacy of the Works;

(b) a description of any operating problems encountered and corrective actions taken;

(c) a summary of all maintenance carried out on any major structure, equipment, apparatus, mechanism or thing forming part of the Works;

(d) a summary of any effluent quality assurance or control measures undertaken in the reporting period;

(e) a summary of the calibration and maintenance carried out on all effluent monitoring equipment; and

(f) a description of efforts made and results achieved in meeting the Effluent Objectives of Condition 5.

(g) a tabulation of the volume of sludge generated in the reporting period, an outline of anticipated volumes to be generated in the next reporting period and a summary of the locations to where the sludge was disposed;

(h) a summary of any complaints received during the reporting period and any steps taken to address the complaints;

(i) a summary of all By-pass, spill or abnormal discharge events;

(j) a copy of all Notice of Modifications submitted to the Water Supervisor as a result of Schedule B, Section 1, with a status report on the implementation of each modification;

(k) a report summarizing all modifications completed as a result of Schedule B, Section 3; and

(l) any other information the Water Supervisor requires from time to time.

Table of Contents

1.	System Description	4
2.	Monitoring Data and Comparison with ECA Objectives and Limits	5
2.1	Discharge Data Report (MECP)	5
2.2	Monitoring Report (WSER)	5
2.3	Influent ECA Monitoring Program Requirements.....	5
2.4	Raw Sewage (Influent) Characteristics: Summary and Interpretation of Reporting Year 6	
2.5	Raw Sewage (Influent) Flow: Summary and Interpretation of Reporting Year	8
2.6	Comparison of Influent Flow to Rated Capacity	9
2.7	Effluent ECA Monitoring Program	11
2.8	Effluent Monitoring Data: Summary and Interpretation of Reporting Year and Comparison to Objectives and Limits.....	12
2.9	Effluent Flow: Summary and Interpretation of Reporting Year.....	17
2.10	Success & Adequacy of the System	18
3.	Operational Issues and Corrective Actions	20
4.	Maintenance Activities	20
4.1	Work Management System.....	20
4.2	Preventative Maintenance Activities.....	20
4.3	Repairs and Improvement.....	21
5.	Effluent Quality Assurance	21
5.1	Adherence to Provincial Regulations	22
5.2	Use of Accredited Laboratories	22
5.3	Operation by Licensed Operators	22
5.4	Sampling and Analysis.....	22
5.5	In-House Analysis	22
5.6	Calibrations.....	22
6.	Calibration of Monitoring Equipment.....	23
7.	Sludge Production and Disposal.....	23
8.	Community Complaints	25
9.	By-Pass, Spill or Abnormal Discharge Events	25
9.1	By-Pass Events	25
9.2	Spill or Abnormal Discharge Events.....	25
10.	Notice of Modifications (Limited Operational Flexibility)	25
11.	Summary of Modifications	26
12.	Other Information	26

2025 Annual Performance Report: January 1, 2025 to December 31, 2025
The Corporation of the Township of Tay: Port McNicoll Wastewater Treatment Plant
Amended ECA # 8421-9PMHXN (Issue Date: October 21, 2014)

List of Appendices

Appendix A – Annual Flow & Effluent Quality Summary (Performance Assessment Report) for 2025

Appendix B – Calibration Reports for 2025

Appendix C – Sludge Quantity and Haulage Records for 2025

Appendix D – Biosolids Quality Data for 2025

This annual performance report is prepared in accordance with Amended Environmental Compliance Approval No. 8421-9PMHXN Section 10.(5) items a) through l) for the for the Port McNicoll Wastewater Treatment Plant for the 'reporting period' of January 1, 2025 to December 31, 2025.

1. System Description

The Port McNicoll Wastewater Treatment Plant (WWTP) is a Class II Treatment and Collection facility. The Port McNicoll WWTP is a membrane bioreactor (MBR) modified activated sludge process plant with chemical addition that serves the Community of Port McNicoll. The works is for the collection, transmission, treatment and disposal of domestic sewage consisting of a Raw Sewage Pumping Station, Sewage Treatment Plant, Biosolids Storage and Outfall Sewer.

Raw sewage is collected at the sewage pumping station, and conveyed to the sewage treatment plant through forcemains. Raw sewage passes through a screw-type mechanical screen or bar screen (standby) to remove larger debris. The sewage is then directed to the aeration system consisting of two train bioreactor tanks with an arrangement of membrane cassettes. The aeration system consists of two anoxic zones (for phosphorous removal and ammonia reduction). Treated effluent flows through UV for disinfection, and is discharged into Hogg Bay. Accumulated sludge is directed through the Zenon sludge thickening process, sludge digester and the sludge storage tank, which is then hauled off-site for land application. The facility is equipped with standby power in the event of a power failure.

An overview of the Port McNicoll Wastewater Treatment System can be found in the following table:

Table 1. Port McNicoll Wastewater Treatment Plant System Overview

Facility Name:	Port McNicoll Wastewater Treatment Plant
Facility Type:	Aeration, Chemical Dosing, Screening, UV Disinfection
Plant Classification:	WWT II, WWC II
Works Number:	110001417
Rated Capacity:	1,918 m ³ /day
Discharge Point:	Hogg Bay
Environmental Compliance Approval:	8421-9PMHXN (Issue Date: October 21, 2014)

2. Monitoring Data and Comparison with ECA Objectives and Limits

ECA 8421-9PMHXN, Section 10.(5)(a) requires:

“A summary and interpretation of all monitoring data and a comparison to the effluent limits outlined in Condition 6, including an overview of the success and adequacy of the Works;”

Where Condition 6 *“is imposed to ensure that the effluent discharged from the Works to the Hogg Bay meets the Ministry’s effluent quality requirements thus minimizing environmental impact on the receiver and to protect water quality, fish and other aquatic life in the receiving water body.”*

2.1 Discharge Data Report (MECP)

The Ontario Clean Water Agency (OCWA) has an agreement with the MECP to submit quarterly discharge data for all OCWA operated municipal sewage treatment facilities 45 days at the end of each quarter. Monitoring data is submitted via the Ministry of Environment Wastewater System (MEWS). The MECP has these reports stored in a shared location where MECP inspectors can obtain and review them. There are no limits/objectives for discharge for the quarterly Discharge Data Report.

2.2 Monitoring Report (WSER)

A monitoring report required under the Wastewater Systems Effluent Regulation (WSER) is submitted on a quarterly basis to the Government of Canada via the Effluent Regulatory Reporting Information System (ERRIS). The quarterly monitoring report requires that the following information be reported for the Port McNicoll WWTP:

- Number of days effluent was deposited
- Total volume of effluent deposited
- Average CBOD (limit of 25 mg/L)
- Average concentration of suspended solids (limit of 25 mg/L)

The monitoring reports were submitted as required for the reporting period and can be found within ERRIS. All results for average CBOD₅ and concentration of suspended solids were below the limits set out in WSER for the Port McNicoll WWTP.

2.3 Influent ECA Monitoring Program Requirements

The following table (Table 2) outlines the influent water quality monitoring program required by the most current ECA for the reporting period. There are additional in-house samples taken and analyzed throughout the year in order to help with process performance monitoring, adjustment, and optimization. These parameters were analyzed by an accredited analytical laboratory (SGS Canada Inc., Lakefield, Ontario).

Table 2. Influent Water Quality Monitoring Program and Sampling Points- as per ECA 8421-9PMHXN Section 9(3) - Table 3- Influent Monitoring

Influent Monitoring		
Raw Sewage Parameter	Type of Sample	Minimum Frequency
Biochemical Oxygen Demand (BOD ₅)	Composite	Bi-Weekly
Suspended Solids	Composite	Bi-Weekly
Total Phosphorus (TP)	Composite	Bi-Weekly
Dissolved Reactive Phosphorus	Composite	Bi-Weekly
Total Kjeldahl Nitrogen (TKN) Ammonia + Ammonium Nitrogen	Composite	Bi-Weekly
Nitrite + Nitrate Nitrogen	Composite	Bi-Weekly
Alkalinity	Composite	Bi-Weekly
Chlorides	Composite	Bi-Weekly
Conductivity	Composite	Bi-Weekly
pH	Composite	Bi-Weekly

2.4 Raw Sewage (Influent) Characteristics: Summary and Interpretation of Reporting Year

The following parameters in Table 3 and 4 are not reportable as they do not have limits or objectives but are monitored as required by the ECA and used to characterize the contents of incoming sewage flow.

A summary of the influent laboratory results can be seen in the following tables (Table 3 and 4) for samples taken and analyzed during the reporting period. Sample results are based on a bi-weekly composite sample taken and analyzed by an accredited external laboratory. A total of 26 influent samples were analyzed for the reporting period.

Table 3: Raw Sewage (Influent) Quality Analysis for 2025

Month	Monthly Influent Concentrations (mg/L)				
	BOD ₅	Total Suspended Solids	Total Phosphorus	Dissolved Reactive Phosphorus	Total Kjeldahl Nitrogen
January	54.50	41.00	0.85	0.12	11.05
February	106.50	169.00	2.00	0.18	17.55
March	61.67	114.33	1.63	<0.46	12.53
April	72.00	146.50	0.70	<0.03	9.40
May	<100.50	59.50	0.79	<0.08	14.50
June	64.00	61.00	1.30	<0.05	17.35
July	145.50	180.50	3.13	<0.47	27.65
August	116.50	148.00	2.47	0.12	25.30

Month	Monthly Influent Concentrations (mg/L)				
	BOD ₅	Total Suspended Solids	Total Phosphorus	Dissolved Reactive Phosphorus	Total Kjeldahl Nitrogen
September	96.33	131.00	2.01	<0.07	20.37
October	75.50	73.00	1.52	0.05	21.20
November	60.50	43.00	0.72	0.12	14.70
December	44.00	45.50	0.66	<0.04	11.85
2025 Annual Average	82.81	102.69	1.51	<0.16	16.92

Table 4: Raw Sewage (Influent) Quality Analysis for 2025

Month	Monthly Influent Concentrations (mg/L)					
	Nitrite + Nitrate Nitrogen	Alkalinity	Chloride	Conductivity	pH	
					Minimum	Maximum
January	1.30	239.50	66.50	759.50	7.12	7.44
February	0.41	223.50	61.50	694.00	7.10	7.24
March	2.59	232.33	81.00	746.33	7.12	7.33
April	0.81	204.50	84.50	716.50	6.92	7.27
May	<0.07	206.50	67.00	735.50	6.90	7.18
June	<0.06	217.50	74.50	734.00	6.83	7.12
July	<0.06	220.50	84.50	839.00	7.04	8.47
August	<0.06	183.50	74.00	494.50	6.53	7.32
September	<0.06	165.67	64.33	611.67	6.82	7.18
October	<0.06	152.50	53.00	575.50	6.86	7.19
November	0.24	188.50	61.50	658.00	6.86	7.10
December	1.04	188.00	66.50	782.00	6.92	7.08
2025 Annual Average	<0.62	205.65	70.12	694.27	-	-

Influent Laboratory analysis for the reporting year is based on samples taken at the inlet of the works. Monthly Influent concentration averages are expressed in mg/L unless otherwise stated. The annual averages for 2025 in Tables 3 are 4, and in comparison, to 2024 and 2023, are either relatively similar or higher:

- The average concentration of BOD₅ in 2025 was 82.81 mg/L was on average 9.77 mg/L higher compared to 2024 (73.08 mg/L) and 2023 (83.07 mg/L)
- The average concentration of TP in 2025 was 1.51 mg/L, 0.31 – 0.33 mg/L higher than compared to 2024 (1.18 mg/L), and 2023 (1.20 mg/L).

- The average concentration of Dissolved Reactive Phosphorus in 2025 was <0.16, which is similar to 2024 (0.10 mg/L), and higher than in 2023 (0.07 mg/L).
- The average concentration of TSS in 2025 was 102.69 mg/L, which was 10.73 to 9.99 mg/L higher than the average in 2024 (91.96 mg/L) and in 2023 (92.70 mg/L).
- The average concentration of TKN in 2025 was 16.92 mg/L, which is slightly higher than in 2024 (15.40 mg/L) and higher than 2023 (12.66 mg/L).
- The average concentration of Nitrite + Nitrate Nitrogen in 2025 was <0.62 mg/L, which is slightly lower than in 2024 (0.67 mg/L) and lower than in 2023 (1.00 mg/L).
- The average concentration of Alkalinity in 2025 was 205.65 mg/L which is similar and slightly lower than in 2024 (210.46 mg/L) and 2023 (208.26 mg/L).
- The average concentration of Chloride in 2025 was 70.12 mg/L, which is higher than in 2024 (66.04 mg/L) and similar to 2023 (70.70 mg/L).
- The average concentration of Conductivity in 2025 was 694.27 µS/cm, which was lower than 2024 (715.27 µS/cm) and comparable to 2023 (696.63 µS/cm).
- The range of minimum and maximum pH results in 2025 was 6.53 – 8.47, which is lower than the 2024 minimum (6.74) and higher than the 2024 maximum (7.71).

2.5 Raw Sewage (Influent) Flow: Summary and Interpretation of Reporting Year

The Rated Capacity listed in the most current ECA for Port McNicoll WWTP is 1,918 cubic meters per day. Typically, the Rated Capacity listed in an ECA is determined based on the highest average annual flow during which the sewage treatment plant can consistently meet site specific effluent quality criteria (as per the Ontario Design Guidelines for Sewage Works); this is usually dictated by the most limiting treatment/process unit in the system. ECA 8421-9PMHXN, Section 5(2) requires the Owner to use its best efforts to (b) operate the works within the Rated Capacity of the Works.

The peak flow rate is the maximum rate of sewage flow for which the plant or process unit was designed. Each process in the treatment system will have its own peak flow rate. The peak flow rate of an entire treatment system is determined by the process unit with the lowest peak flow rate. For Port McNicoll WWTP, the plant peak flow rate is limited by the Inlet Works, which has a peak flow rate of 3,836 cubic meters per day

2.6 Comparison of Influent Flow to Rated Capacity

A summary of influent flows data and comparison to the Rated Capacity during the reporting period can be found in the below table and graph.


Table 5. Raw Sewage (Influent) Flow Data during Reporting Period

Month	Average Influent Flow (m ³ /day)	% of Rated Capacity (1,918 m ³ /day)	Maximum Influent Flow (m ³ /day)	% of Plant Peak Flow Rate (3,836 m ³ /day)	Total Influent Flow (m ³)
January	1,253.29	65.34%	2,657.00	69.26%	38,852.00
February	821.96	42.86%	1,147.00	29.90%	23,015.00
March	2,585.77	134.82%	6,648.00	173.31%	80,159.00
April	1,980.50	103.26%	4,899.00	127.71%	59,415.00
May	1,031.65	53.79%	1,344.00	35.04%	31,981.00
June	715.53	37.31%	974.00	25.39%	21,465.82
July	599.68	31.27%	917.00	23.91%	18,590.00
August	529.84	27.62%	672.00	17.52%	16,425.00
September	577.53	30.11%	647.00	16.87%	17,326.00
October	570.06	29.72%	770.00	20.07%	17,672.00
November	1,024.03	53.39%	1,540.00	40.15%	30,721.00
December	1,160.29	60.49%	2,006.00	52.29%	35,969.00
2025	1,072.85	55.94%	6,648.00	173.31%	391,590.82

Note: As per the ECA, 'Rated Capacity' is defined as "the Average Daily Flow for which the Works are approved to handle".

Note: As per the ECA, 'Average Daily Flow' is defined as "the cumulative total sewage flow to the sewage works during a calendar year divided by the number of days during which sewage was flowing to the sewage works that year".

Figure 1. Peak Flow versus Rated Capacity and Peak Flow Rate during the Reporting Period

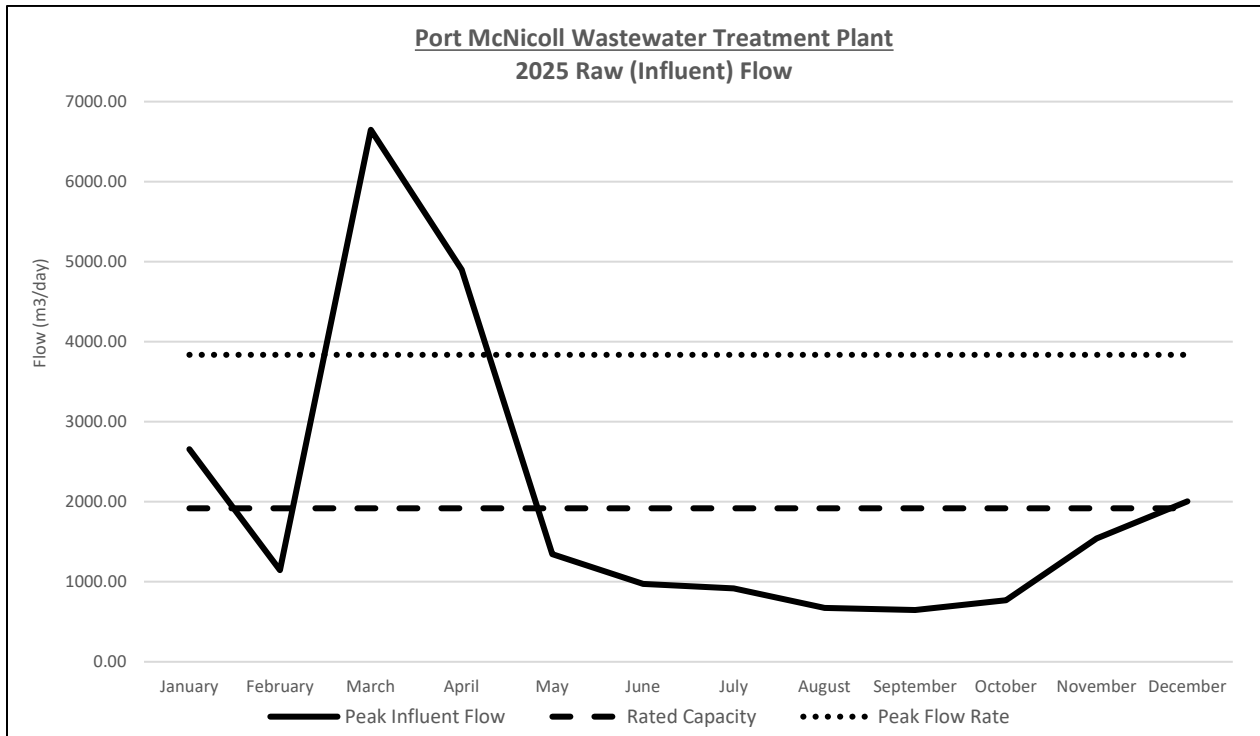

The average daily flow of 1,072.85 m³ is based on the total flow for the reporting period divided by the number of operational days (i.e. 365) as per the 'Average Daily Flow' definition in the ECA.

Based on the definition of the Rated Capacity, a single exceedance does not necessarily result in a non-compliance event, however, if a system continually exceeds its Rated Capacity, this could result in reduced treatment efficiency and lead to effluent objective exceedances. If the Annual Average Daily Flow reaches/exceeds 80% of the Rated Capacity, current best practice is to assess issues and provide recommendations for proactive actions.

For 2025, the Annual Average Daily Flow was below 80% of the 'Rated Capacity' at 55.94% of the 'Rated Capacity'. There were instances in the reporting year when the system operated outside of the Rated Capacity and peak flow capacity. These instances occurred:

- Throughout March, 2025 which resulted in the average daily flowrate for the month to be 2,585.77 m³ (134.82% of the rated capacity). The maximum daily flow for the month occurred on March 16 – 6,648.00 m³, which is 173.31% of the peak design flow.
- Throughout April, 2025 which resulted in the average daily flowrate for the month to be 1,980.50 m³ (103.26% of the rated capacity). The maximum daily flow for the month occurred on April 3 – 4,899.00 m³, which is 127.71% of the peak design flow,
- The highest recorded peak flow events in both March and April are both attributed to extreme weather events (ice storm in March) and unseasonably warmer temperatures and rainfall events.

Refer to *Appendix A* for detailed monthly raw sewage (influent) flows at the facility.

2.7 Effluent ECA Monitoring Program

The following table outlines the effluent monitoring program at the Port McNicoll WWTP as required by the most current ECA for the reporting period. There are additional in-house samples collected and analyzed throughout the year to aid process performance monitoring, adjustment, and optimization.

Table 6. Effluent Water Quality Monitoring Program and Sampling Points- as per ECA 8421-9PMHXN Section 9(3)- Table 4- Effluent Monitoring

Effluent Monitoring		
Final Effluent Parameter	Type of Sample	Minimum Frequency
CBOD ₅	Composite	Bi-Weekly
Suspended Solids	Composite	Bi-Weekly
Total Phosphorus	Composite	Bi-Weekly
Dissolved Reactive Phosphorus	Composite	Bi-Weekly
Total Kjeldahl Nitrogen Ammonia + Ammonium Nitrogen	Composite	Bi-Weekly
Nitrite + Nitrate Nitrogen	Composite	Bi-Weekly
Alkalinity	Composite	Bi-Weekly
Chlorides	Composite	Bi-Weekly
Conductivity	Composite	Bi-Weekly
pH	Composite	Bi-Weekly
<i>E.Coli</i>	Grab	Weekly

Note: CBOD₅ = Carbonaceous Biochemical Oxygen Demand

The following tables outline the final effluent objectives, limits and loadings at the Port McNicoll WWTP as per its ECA. The applicable effluent parameters are either “concentrations” expressed as milligrams per litre or “loadings” expressed as kilograms per day.

As per Section 6, Concentration Limits for CBOD₅, TSS, TP, and TAN are reportable based on a monthly average effluent concentration, *E.Coli* based on a monthly Geometric Mean Density, pH based on a Single Sample Result, and the Loading Limits are reportable based on a Monthly Average Daily Effluent Loading.

Table 7: Final Effluent Design Objectives- as per ECA 8421-9PMHXN Section 5(1)- Table 1- Effluent Objectives

Effluent Water Quality Objectives		
Effluent Parameter	Effluent Concentration Objective (mg/L unless otherwise indicated)	Total Loading Objective (kg/day unless otherwise indicated)
Carbonaceous Biochemical Oxygen Demand (CBOD ₅)	7.0	13.43
Total Suspended Solids	7.0	13.43
Total Phosphorus	0.15	0.29
Ammonia + Ammonium Nitrogen (June 1 – August 31)	2.0	3.8
<i>E.Coli</i>	200 organisms/100 mL	--
pH of the effluent maintained between 6.5 to 9.0, inclusive, at all times		

Table 8. Final Effluent Design Limits- as per ECA 8421-9PMHXN Section 6(1)- Table 2- Effluent Limits

Effluent Water Quality Limits			
Effluent Parameter	Effluent Concentration Limit (mg/L)	Waste Loading Limit (Kg/day)	Reportable
CBOD ₅	15.00	28.77	Monthly
Total Suspended Solids	15.00	28.77	Monthly
Total Phosphorus	0.25	0.48	Monthly
Ammonia + Ammonium Nitrogen (June 1 – August 31)	5.00	9.59	Monthly
Ammonia + Ammonium Nitrogen (September 1 to May 31)	15.00	28.77	Monthly
<i>E.Coli</i>	200 organisms/100 mL	--	Monthly
pH of the effluent maintained between 6.0 to 9.5, inclusive, at all times			

2.8 Effluent Monitoring Data: Summary and Interpretation of Reporting Year and Comparison to Objectives and Limits

ECA 8421-9PMHXN, Section 10.(5)(a) requires:

“A summary and interpretation of all monitoring data and a comparison to the effluent limits outlined in Condition 6, including an overview of the success and adequacy of the Works;” where Condition 6 “is imposed to ensure that the effluent discharged from the Works to the Hogg Bay meets the Ministry’s effluent quality requirements thus minimizing environmental impact on the receiver and to protect water quality, fish and other aquatic life in the receiving water body.”

and where ECA 8421-9PMHXN, section 10(5)(f) requires:

“A description of efforts made and results achieved in meeting the Effluent Objectives of Condition 5;” where Condition 5 “is imposed to establish non-enforceable effluent quality objectives which the Owner is obligated to use best efforts to strive towards on an ongoing basis. These objectives are to be used as a mechanism to trigger corrective action proactively and voluntarily before environmental impairment occur and before the compliance limits of Condition 6 are exceeded.”

The following tables (Table 9 to 14) summarize the effluent water quality for the reporting period in comparison with the ECA compliance objectives and limits.

A review of the effluent monitoring data shows that the following parameters were within the objectives (as applicable) and limits set out in the most current ECA for the duration of the 2025 reporting period:

- CBOD₅ monthly average effluent concentration
- CBOD₅ monthly average daily effluent loading
- TSS monthly average effluent concentration
- TSS monthly average daily effluent loading
- TAN monthly average effluent concentration
- TAN monthly average daily effluent loading
- *E.Coli* monthly geometric density

A review of the effluent monitoring data shows that the following parameters were within the limits set out in the most current ECA for the duration of reporting period but were unable to meet the objectives in the following instances:

- TP – monthly average daily effluent concentration – July 2025

It should be noted that as per the ECA, the objectives are non-enforceable design objectives to be used as a mechanism to trigger corrective action proactively and voluntarily before environmental impairment occurs. Exceedances of objectives is not reportable.

Refer to *Appendix A* 2025 Performance Assessment Report for a more detailed description of monthly sample results.

Table 9: Effluent Sampling Results: CBOD5 and CBOD5 Loading Concentrations

Month	Monthly Average (mg/L)	Within Limits (15.0 mg/L)	Within Objectives (7.0 mg/L)	Monthly Loading (kg/d)	Within Waste Loading Limit (28.77 kg/d)
January	<2.00	Yes	Yes	<2.823	Yes
February	<2.00	Yes	Yes	<1.853	Yes
March	<2.00	Yes	Yes	<5.522	Yes
April	<2.00	Yes	Yes	<4.330	Yes

2025 Annual Performance Report: January 1, 2025 to December 31, 2025
 The Corporation of the Township of Tay: Port McNicoll Wastewater Treatment Plant
 Amended ECA # 8421-9PMHXN (Issue Date: October 21, 2014)

Month	Monthly Average (mg/L)	Within Limits (15.0 mg/L)	Within Objectives (7.0 mg/L)	Monthly Loading (kg/d)	Within Waste Loading Limit (28.77 kg/d)
May	<2.00	Yes	Yes	<2.277	Yes
June	<2.00	Yes	Yes	<1.694	Yes
July	<2.00	Yes	Yes	<1.395	Yes
August	<2.00	Yes	Yes	<1.255	Yes
September	<2.00	Yes	Yes	<1.382	Yes
October	<2.00	Yes	Yes	<1.391	Yes
November	<2.00	Yes	Yes	<2.347	Yes
December	<2.00	Yes	Yes	<2.635	Yes

**As per the ECA, CBOD5 Concentration Averaging Calculator is a Monthly Average Effluent Concentration*

**As per the ECA, CBOD5 Loading Limits Concentration Averaging Calculator is a Monthly Average Daily Effluent Loading*

Table 10: Effluent Sampling Results: TSS Concentration and TSS Loading

Month	Monthly Average (mg/L)	Within Limits (15.0 mg/L)	Within Objectives (7.0 mg/L)	Monthly Loading (kg/d)	Within Waste Loading Limit (28.77 kg/d)
January	<2.00	Yes	Yes	<2.823	Yes
February	<2.00	Yes	Yes	<1.853	Yes
March	<2.00	Yes	Yes	<5.522	Yes
April	<2.00	Yes	Yes	<4.330	Yes
May	<2.00	Yes	Yes	<2.277	Yes
June	2.50	Yes	Yes	2.118	Yes
July	<2.00	Yes	Yes	<1.395	Yes
August	<2.00	Yes	Yes	<1.255	Yes
September	<2.00	Yes	Yes	<1.382	Yes
October	<2.00	Yes	Yes	<1.391	Yes
November	<2.00	Yes	Yes	<2.347	Yes
December	<2.00	Yes	Yes	<2.635	Yes

**As per the ECA, TSS Concentration Averaging Calculator is a Monthly Average Effluent Concentration*

**As per the ECA, TSS Loading Limits Concentration Averaging Calculator is a Monthly Average Daily Effluent Loading*

Table 11: Effluent Sampling Results: TP and TP Loading Concentrations

Month	Monthly Average (mg/L)	Within Limits? (0.25 mg/L)	Within Objectives? (0.15 mg/L)	Monthly Loading (kg/d)	Within Waste Loading Objective? (0.29 kg/d)	Within Waste Loading Limit? (0.48 kg/d)
January	<0.03	Yes	Yes	<0.042	Yes	Yes
February	<0.03	Yes	Yes	<0.028	Yes	Yes
March	<0.03	Yes	Yes	<0.083	Yes	Yes
April	<0.03	Yes	Yes	<0.065	Yes	Yes
May	<0.03	Yes	Yes	<0.034	Yes	Yes
June	0.06	Yes	Yes	0.047	Yes	Yes
July	0.16	Yes	No	0.108	Yes	Yes
August	0.14	Yes	Yes	0.088	Yes	Yes
September	0.08	Yes	Yes	0.058	Yes	Yes
October	0.06	Yes	Yes	0.042	Yes	Yes
November	<0.03	Yes	Yes	<0.035	Yes	Yes
December	<0.03	Yes	Yes	<0.040	Yes	Yes

**As per the ECA, TP Concentration Averaging Calculator is a Monthly Average Effluent Concentration*

**As per the ECA, TP Loading Limits Concentration Averaging Calculator is a Monthly Average Daily Effluent Loading*

Table 12: Effluent Sampling Results: TAN and TAN Loading Concentrations

Month	Monthly Average (mg/L)	Within Monthly Objective (2.0 mg/L)	Within Monthly Compliance Limit (5.0 mg/L Jun 1 – Aug 31) (15 mg/L Sept 1 – May 31)	Monthly Loading (kg/d)	Within Waste Loading Objective (3.8 kg/d)	Within Waste Loading Limit (9.59 kg/d Jun 1 – Aug 31) (28.77 kg/d Sept 1 – May 31)
January	<0.10	Yes	Yes	<0.141	Yes	Yes
February	<0.10	Yes	Yes	<0.093	Yes	Yes
March	<0.10	Yes	Yes	<0.276	Yes	Yes
April	<0.10	Yes	Yes	<0.217	Yes	Yes
May	<0.10	Yes	Yes	<0.114	Yes	Yes
June	<0.10	Yes	Yes	<0.085	Yes	Yes
July	<0.10	Yes	Yes	<0.070	Yes	Yes
August	<0.10	Yes	Yes	<0.063	Yes	Yes
September	<0.10	Yes	Yes	<0.069	Yes	Yes
October	<0.10	Yes	Yes	<0.070	Yes	Yes
November	<0.10	Yes	Yes	<0.117	Yes	Yes
December	<0.10	Yes	Yes	<0.132	Yes	Yes

**As per the ECA, TAN Concentration Averaging Calculator is a Monthly Average Effluent Concentration*

**As per the ECA, TAN Loading Limits Concentration Averaging Calculator is a Monthly Average Daily Effluent Loading*

Table 13: Effluent Sampling Results: E.Coli Concentrations

Month	Monthly Geometric Mean Density (MPN/100 mL)	Within Monthly Objective and Compliance Limit (200 organisms/100 mL)
January	1.00	Yes
February	1.00	Yes
March	1.00	Yes
April	1.00	Yes
May	1.00	Yes
June	1.00	Yes
July	1.00	Yes
August	1.00	Yes
September	1.00	Yes
October	1.00	Yes
November	1.00	Yes
December	1.00	Yes

**As per the ECA, E.Coli Concentration Averaging Calculator is a Monthly Geometric Density*

Table 14. Effluent Quality Data during Reporting Period: pH

Month	pH				
	Min.	Max.	Number of Samples Taken	Within Objective (6.5 – 9.0) Inclusive, at all times	Within Limits (6.0 – 9.5) Inclusive, at all times
January	7.13	7.47	16	Yes	Yes
February	7.00	7.13	13	Yes	Yes
March	7.09	7.32	14	Yes	Yes
April	7.03	7.36	21	Yes	Yes
May	6.76	7.16	20	Yes	Yes
June	6.74	7.13	21	Yes	Yes
July	6.75	7.84	22	Yes	Yes
August	6.77	7.51	21	Yes	Yes
September	6.63	7.06	18	Yes	Yes
October	6.64	6.88	17	Yes	Yes
November	6.64	7.25	14	Yes	Yes
December	6.83	7.35	15	Yes	Yes

Refer to the below section (Section 2.10) for a comparison of effluent discharge data compared to the ECA objectives, limits and loadings with relation to the success and adequacy of the system.


2.9 Effluent Flow: Summary and Interpretation of Reporting Year

The following table outlines the final effluent average daily flow data in 2025 and the graph shows the final effluent daily and peak final effluent flow by month for the reporting period.

Table 15: Final Effluent Average Daily Flow and Peak Flow Data by Month for 2025

Month	Average Daily Effluent (m³/day)	Peak Daily Effluent (m³/day)	Total (m³/day)
January	1,411.55	3,060.00	43,758.00
February	926.57	1,231.00	25,944.00
March	2,760.87	5,117.00	85,587.00
April	2,165.07	3,714.00	64,952.00
May	1,138.58	1,466.00	35,296.00
June	847.03	1,039.00	25,411.00
July	697.42	1,053.00	21,620.00
August	627.45	780.00	19,451.00
September	690.80	764.00	20,724.00
October	695.39	924.00	21,557.00
November	1,173.53	1,779.00	35,206.00
December	1,317.65	2,158.00	40,847.00
2025	1,206.45	5,117.00	440,353.00

Figure 2: 2025 Average Daily and Peak Daily Final Effluent Flow by Month

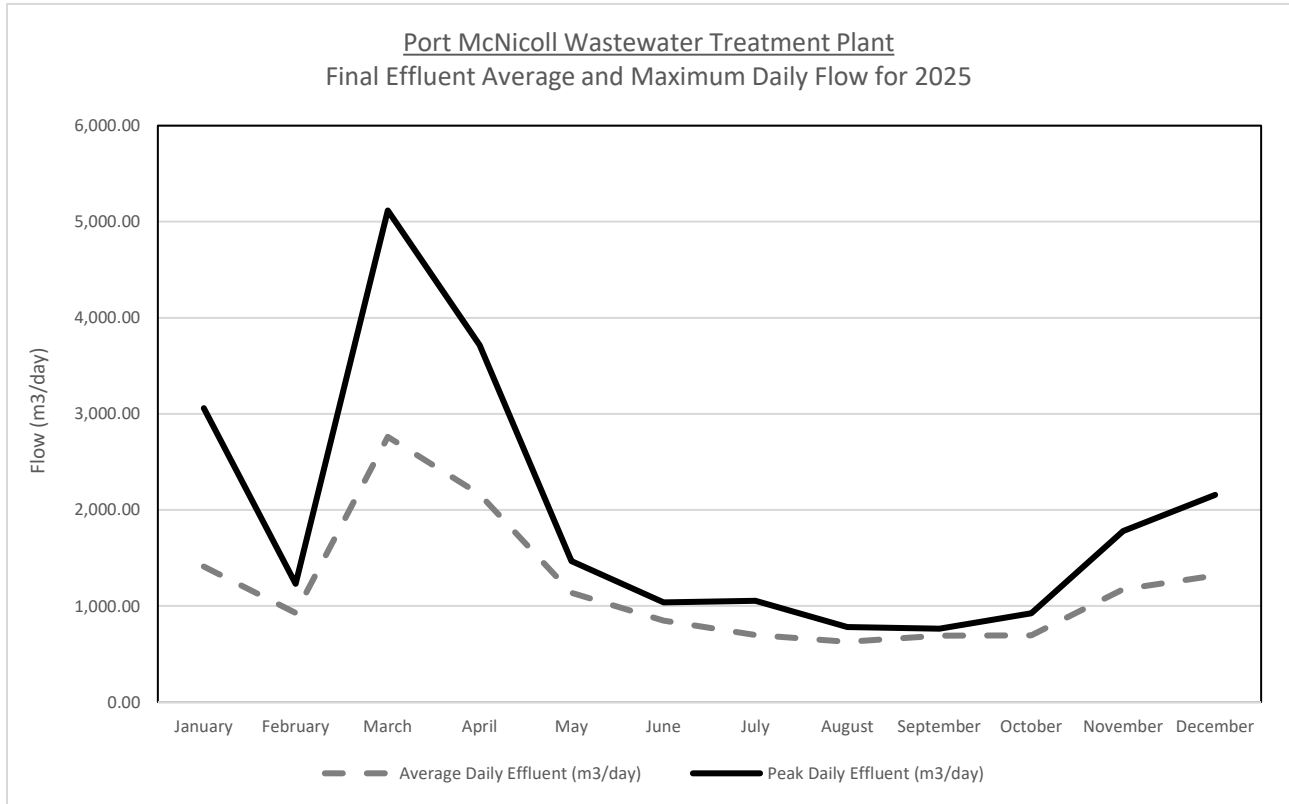

During the reporting period, the average annual daily flow for final effluent to outfall (Hogg Bay) was 1,206.45 m³/day. The maximum peak final effluent daily flow was 5,117.00 m³/day, which occurred on March 17, 2025, corresponding with the maximum peak daily influent flows experienced on March 16, 2025 (see section 2.6).

2.10 Success & Adequacy of the System

ECA 8421-9PMHXN, Section 10.(5)(a) requires:

“A summary and interpretation of all monitoring data and a comparison to the effluent limits outlined in Condition 6, including an overview of the success and adequacy of the Works;” where Condition 6 “is imposed to ensure that the effluent discharged from the Works to the Hogg Bay meets the Ministry’s effluent quality requirements thus minimizing environmental impact on the receiver and to protect water quality, fish and other aquatic life in the receiving water body.”

In 2025 Port McNicoll WWTP produced effluent with the following removal rates:

Parameter	Percent Removal
CBOD ₅	97.30
Total Suspended Solids	97.30
Total Phosphorus	96.11

During the 2025 reporting period, Port McNicoll WWTP provided effective wastewater treatment, producing effluent with removal rates for above 96% for CBOD₅, Total Suspended Solids, and Total Phosphorus.

Based on the monitoring program and effluent quality data, the Port McNicoll WWTP provided effective wastewater treatment for all wastewater parameters. This facility was in compliance with all of the effluent concentration and loading limits for the reporting year, there were no reportable non-compliance incidents. The bacteriological quality of the effluent complied with the ECA monthly geometric mean density of less than 200 *E.Coli* organisms per 100 mL sample of effluent discharged from the plant, which indicates effective effluent disinfection.

For the duration of the reporting period, CBOD₅ remained in compliance with ECA compliance limits (15 mg/L), objectives (7.0 mg/L), waste loading limits (28.77 kg/d) and waste loading objectives (13.43 kg/d). See *Section 2.5 Table 9* for a breakdown of month-to-month discharge sampling results.

For the duration of the reporting period, Total Suspended Solids remained in compliance with ECA compliance limits (15 mg/L), objectives (7.0 mg/L) and waste loading limits (28.77 kg/d) and objectives (13.43 kg/d). See *Section 2.5 Table 10* for a breakdown of month-to-month discharge sampling results.

For the duration of the reporting period, Total Phosphorus remained in compliance with ECA compliance limits (0.25 mg/L), waste loading limits (0.48 kg/d), and waste loading objectives (0.29 kg/d). There was one instance where the Total Phosphorus exceeded the monthly compliance objective (0.15 mg/L) in July, 2025, due to a single sample exceedance on July 21, 2025. This was caused by low rainfall in the summer months and therefore the average coagulant dose for the summer months was lower than typical. The lower coagulant dose caused the total phosphorus to increase. In response, operations staff increase the coagulant dosing pump feed rate, resolving the issues. No further objective exceedances occurred during the reporting year and TP was in compliance with the ECA limits. See *Section 2.5 Table 11* for a breakdown of month-to-month discharge sampling results.

For the duration of the reporting period, Total Ammonia Nitrogen remained in compliance with ECA compliance limits (5.0 mg/L – June 1 – August 31, and 15 mg/L – September 1 – May 31) and objective limits (2.0 mg/L – June 1 – August 31), and waste loading limits (3.8 kg/d) and waste loading objectives (28.77 kg/d – September 1 – May 31). See *Section 2.5 Table 12* for a breakdown of month-to-month discharge sampling results.

For the duration of the reporting period, pH remained in compliance with both ECA compliance limits (6.0 – 9.5, inclusive) and objectives (6.5 – 9.0, inclusive). See *Section 2.5 Table 14* for a breakdown of month-to-month discharge sampling results.

For 2025, best efforts were used to operate the works within the rated capacity of the system. For the reporting period, the annual average Daily Influent flow was 1,070.84, which was below 80% of the Rated Capacity at 55.83%. Best efforts were also made to ensure that the effluent from the works was free of floating and settleable solids and did not contain oil or any other substances in amounts sufficient to create a visible film or sheen or foam or discoloration on the receiving waters.

3. Operational Issues and Corrective Actions

ECA 8421-9PMHXN, Section 10 (5)(b) requires:

“A description of any operating problems encountered and corrective actions taken;”

There were no (0) operational problems encountered during the reporting period.

4. Maintenance Activities

ECA 8421-9PMHXN, section 10(5)(c) requires:

“A summary of all maintenance carried out on any major structure, equipment, apparatus, mechanism or thing forming a part of the works;”

4.1 Work Management System

Planned maintenance, including scheduled and non-scheduled maintenance activities are scheduled using a computerized Work Management System (WMS) that allows user to:

- Enter detailed asset information
- Generate and process work orders
- Access maintenance and inspection procedures
- Plan, schedule, and document all asset related tasks and activities
- Access maintenance records and asset histories

Work Orders are automatically generated by the WMS program and are assigned to the applicable Operations staff.

4.2 Preventative Maintenance Activities

Several preventative maintenance tasks were completed throughout the reporting period, including the following:

- Monthly Generator Testing
- Monthly Alarm Testing
- Monthly Alum Pump Inspection
- Monthly UV Inspections
- Monthly Train #1/#2 Inspections and Dip Tank Cleaning

- Monthly Autosampler (Influent and Effluent) Inspections
- Change Rag Bag – As required
- Monthly Verifications and Calibrations
- Monthly Headworks Inspections
- Monthly Process and Blowers Inspections
- Annual Pump Maintenance
- Annual Third-Party Calibrations

4.3 Repairs and Improvement

Several repairs and improvements were completed throughout the reporting period, including the following:

- Compressor Pumps Servicing
- Alarm Upgrades
- Valve Maintenance
- PLC Upgrades
- UV Bank Service
- Sewer Lateral Repair
- Belt Replacement
- Blower Maintenance
- Membrane Replacement
- 3 Heater Units Replacement
- Compressor Programming
- New Mixer Installed
- Blower Rebuilds
- Pump Rebuilds
- New Lighting Added to Permeate Room

5. Effluent Quality Assurance

ECA 8421-9PMHXN, section 10(5)(d) requires:

“A summary of any effluent quality assurance or control measures undertaken in the reporting period;”

Quality assurance and control measures undertaken during the reporting period include adherence to provincial regulations, use of accredited laboratories, operation of the system by licensed Operators, scheduled sampling and analysis, in-house laboratory analysis and calibration of equipment. The sections below provide further details of these measures.

5.1 Adherence to Provincial Regulations

The Ontario Clean Water Agency operates the Port McNicoll WWTP in accordance with provincial regulations and the Environmental Compliance Approval.

5.2 Use of Accredited Laboratories

Analytical tests to monitor the effluent quality are conducted by a laboratory audited by the Canadian Association for Laboratory Accreditation Inc. (CALA) and accredited by the Standards Council of Canada (SCC). Accreditation ensures that the laboratory has acceptable laboratory protocols and test methods in place. It also requires the laboratory to provide evidence and assurances of the proficiency of the analysts performing the test methods. During the reporting period, all chemical sample analyses were conducted by SGS (Lakefield) Canada Inc.

5.3 Operation by Licensed Operators

Port McNicoll WWTP is operated and maintained by licensed Operators. The mandatory licensing program for operators of sewage treatment facilities in Ontario is regulated under the Ontario Water Resources Act (OWRA) Regulation 435/93 and Ontario Regulation 129/04. A Licensed individual has successfully passed the licensing exam and meets the education and experience requirements set out in the regulation.

5.4 Sampling and Analysis

The Ontario Clean Water Agency followed a sampling and analysis schedule that meets the requirements of the ECA.

5.5 In-House Analysis

In-house analyses were conducted by Licensed Operators for monitoring purposes using Standard Methods. The data generated from these tests is used to determine treatment efficiency while maintaining process control. All in-house monitoring equipment is calibrated based on the manufacturer's recommendations. The Operators of the facility continue to use their expertise in order to meet our objective of no exceedances of the ECA Effluent Compliance Limits and OCWA will continue to make best efforts to meet the ECA Effluent Objectives.

5.6 Calibrations

Third-party and in-house calibrations are completed on various equipment and monitoring and analysis items as required based on manufacturer's recommendations. Refer to Section 6 for more information regarding calibration of monitoring equipment.

6. Calibration of Monitoring Equipment

ECA 8421-9PMHXN, section 10(5)(e) requires:

“A summary of the calibration and maintenance carried out on all effluent monitoring equipment;”

The flow meters used to measure raw sewage (influent) and final effluent at Port McNicoll WWTP were calibrated on July 30, 2025 by Indus Control. All program parameters received a passing inspection. Refer to *Appendix B* for detailed calibration records/reports.

7. Sludge Production and Disposal

ECA 8421-9PMHXN, section 10(5)(g) requires:

“A tabulation of the volume of sludge generated in the reporting period, an outline of anticipated volumes to be generated in the next reporting period and a summary of the locations to where the sludge was disposed;”

During the reporting period, a total volume of 1,218.00 m³ of sludge was produced at the Port McNicoll WWTP and hauled by Region of Huronia Environmental Services (ROHES). The sludge was either delivered to lagoons for storage or applied as soil conditioner to agricultural land to Non-Agricultural Source Material Plan (NASM Plan) sites/locations which were approved by the Ontario Ministry of Agriculture, Food and Rural Affairs (OMAFRA) under Ontario Regulation 338/09. NASM Plans under the Nutrient Management Act are issued to the owner (farmer) who is responsible for managing this plan with assistance from the NASM Plan Developer.

Refer to Table 16 for a tabulation of the hauled sludge and the locations of where the sludge was disposed and *Appendix C* a detailed record of specific sludge haulage dates and volumes.


Table 16. Sludge Hauling during the Reporting Period

Haulage Months	Location	NASM Plan #	Volume of Sludge Hauled (m ³)
April	RHOES Storage Lagoon	N/A	462.00
August	Home/Far Side-Field	24872	546.00
October	Rowe-Field 1	62622	210.00
Total Sludge Haulage to RHOES Storage Lagoon			462.00
Total Sludge Haulage to NASM #24872, Farm ‘Home/FarSide’			546.00
Total Sludge Haulage to NASM #62622, Farm ‘Rowe’			210.00
Total Sludge Haulage for 2025			1,218.00

During the reporting period, a total volume of 1,218.00 m³ of sludge was hauled from Port McNicoll WWTP. Compared to 2024 (1,736.80 m³), this was a decrease of 518.80 m³ or approximately 29.87% decrease in the volume of sludge hauled from 2024 to 2025.

To estimate the volume of sludge generated in the next reporting period, a linear regression using data from previous years was used. The regression model estimates the sludge volume for 2026 to be approximately 1,483.78 m³ or 1295.23 (if you remove the 2024 results based on outlier-adjusted regression). The accuracy of this estimate is affected by the R² value, the closer the R² value is to 100%, the better the regression model fits to the data. The accuracy of the regression model is 33.5% (non-adjusted regression) and 59.2% (with outlier-adjusted regression). Operations staff will continue to optimize the dewatering process to reduce the relative volume of sludge.

Figure 3. Port McNicoll Wastewater Treatment Plant Sludge Haulage Volumes

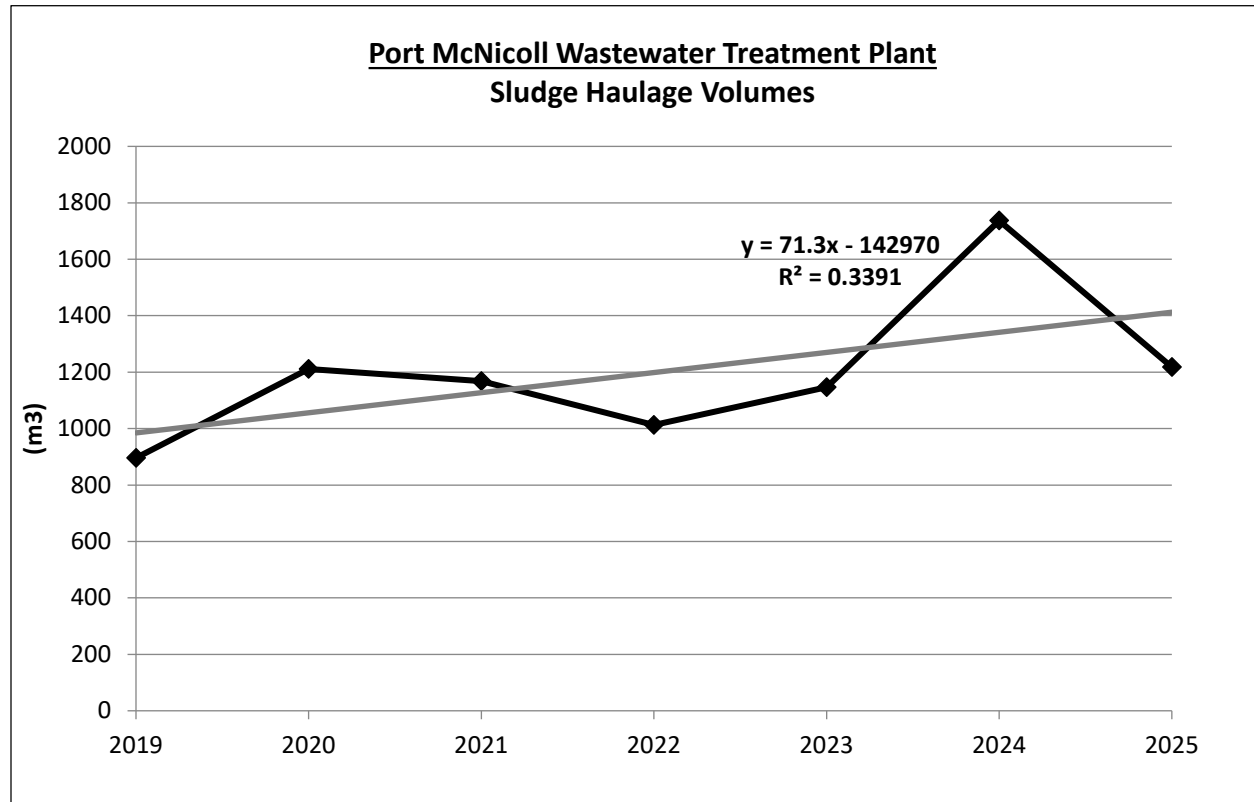

Biosolids produced at the Port McNicoll WWTP met all the quality criteria specified in the Regulation for the reporting period. A summary of the Port McNicoll WWTP sludge quality with a comparison to quality criteria can be referenced in *Appendix D*.

8. Community Complaints

ECA 8421-9PMHXN, section 10(5)(h) requires:

“A summary of any complaints received during the reporting period and any steps taken to address the complaints;”

There is a standard operating procedure (SOP) in place that outlines the required steps for receiving and addressing community complaints. All complaints are to be discussed and/or investigated, and resolved as necessary. Each complaint is documented in detail in the facility logbook and key information is then entered into the Work Management System (WMS). The WMS maintains the full history of complaints with the relevant supporting details.

For the reporting period, no community complaints were received.

9. By-Pass, Spill or Abnormal Discharge Events

ECA 8421-9PMHXN, section 10(5)(i) requires:

“A summary of all By-pass, spill or abnormal discharge event;”

All quarterly by-pass reports were submitted to the MECP, as required in the ECA, for the reporting period.

9.1 By-Pass Events

There were no reportable bypass events for the reporting period.

9.2 Spill or Abnormal Discharge Events

There were no reportable spill or abnormal discharge events for the reporting period.

10. Notice of Modifications (Limited Operational Flexibility)

ECA 8421-9PMHXN, section 10(5)(j) requires:

“A copy of all Notice of Modifications submitted to the Water Supervisor as a result of Schedule B, Section 1, with a status report on the implementation of each modification;” where “Schedule B, Section 1 is the “Limited Operational Flexibility Criteria for Modifications to Municipal Sewage Works.”

There were no Notices of Modifications completed that required submission to the Water Supervisor during the reporting period.

11. Summary of Modifications

ECA 8421-9PMHXN, section 10(5)(k) requires:

“A report summarizing all modifications completed as a result of Schedule B, Section 3;” where Schedule B, Section 3 refers to “normal or emergency operational modifications, such as repairs, reconstructions, or other improvements that are part of maintenance activities, including cleaning, renovations to existing approved sewage works equipment, provided that the modification is made with Equivalent Equipment, are considered pre-approved.”

Normal or emergency operational modifications, such as repairs, reconstructions, or other improvements that are part of maintenance activities, including cleaning, renovations to existing approved sewage works equipment are included in Section 4 of this report.

12. Other Information

ECA 8421-9PMHXN, section 10(5)(l) requires:

“Any other information the Water Supervisor requires from time to time.”

There was no information required from the Water Supervisor during the reporting period.

2025 Performance Assessment Report

Appendix A

Annual Flow & Effluent Quality Summary

1676 PORT MCNICOLL WASTEWATER TREATMENT FACILITY 110001417

	1/ 2025	2/ 2025	3/ 2025	4/ 2025	5/ 2025	6/ 2025	7/ 2025	8/ 2025	9/ 2025	10/ 2025	11/ 2025	12/ 2025	<--Total-->	<--Avg-->	<--Max-->	<-Criteria-->
Flows																
Raw Flow: Total - Raw Sewage m³/d	38,852.00	23,015.00	80,159.00	59,415.00	31,981.00	21,465.82	18,590.00	16,425.00	17,326.00	17,672.00	30,721.00	35,969.00	391,590.82			0.00
Raw Flow: Avg - Raw Sewage m³/d	1,253.29	821.96	2,585.77	1,980.50	1,031.65	715.53	599.68	529.84	577.53	570.06	1,024.03	1,160.29		1,072.85		1,918.00
Raw Flow: Max - Raw Sewage m³/d	2,657.00	1,147.00	6,648.00	4,899.00	1,344.00	974.00	917.00	672.00	647.00	770.00	1,540.00	2,006.00			6,648.00	0.00
Raw Flow: Count - Raw Sewage m³/d	31.00	28.00	31.00	30.00	31.00	30.00	31.00	31.00	30.00	31.00	30.00	31.00	365.00			0.00
Eff. Flow: Total - Final Effluent m³/d	43,758.00	25,944.00	85,587.00	64,952.00	35,296.00	25,411.00	21,620.00	19,451.00	20,724.00	21,557.00	35,206.00	40,847.00	440,353.00			0.00
Eff. Flow: Avg - Final Effluent m³/d	1,411.55	926.57	2,760.87	2,165.07	1,138.58	847.03	697.42	627.45	690.80	695.39	1,173.53	1,317.65		1,206.45		
Eff. Flow: Max - Final Effluent m³/d	3,060.00	1,231.00	5,117.00	3,714.00	1,466.00	1,039.00	1,053.00	780.00	764.00	924.00	1,779.00	2,158.00			5,117.00	0.00
Eff Flow: Count - Final Effluent m³/d	31.00	28.00	31.00	30.00	31.00	30.00	31.00	31.00	30.00	31.00	30.00	31.00	365.00			0.00
Carbonaceous Biochemical Oxygen Demand: CBOD																
Eff: Avg cBOD5 - Final Effluent mg/L	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00		< 2.00		15.00
Eff: # of samples of cBOD5 - Final Effluent	2.00	2.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	2.00	2.00	2.00	26.00			0.00
Loading: cBOD5 - Final Effluent kg/d	< 2.823	< 1.853	< 5.522	< 4.330	< 2.277	< 1.694	< 1.395	< 1.255	< 1.382	< 1.391	< 2.347	< 2.635		< 2.41	< 5.52	28.770
Biochemical Oxygen Demand: BOD5																
Raw: Avg BOD5 - Raw Sewage mg/L	54.50	106.50	61.67	72.00	< 100.50	64.00	145.50	116.50	96.33	75.50	60.50	44.00		82.81	145.50	0.00
Raw: # of samples of BOD5 - Raw Sewage	2.00	2.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	2.00	2.00	2.00	26.00			0.00
Percent Removal: BOD5 - Raw Sewage %	96.33	98.12	96.76	97.22	< 98.01	96.88	98.63	98.28	97.92	97.35	96.69	95.45		97.30	98.63	0.00
Total Suspended Solids: TSS																
Raw: Avg TSS - Raw Sewage mg/L	41.00	169.00	114.33	146.50	59.50	61.00	180.50	148.00	131.00	73.00	43.00	45.50		102.69	180.50	0.00
Raw: # of samples of TSS - Raw Sewage	2.00	2.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	2.00	2.00	2.00	26.00			0.00
Eff: Avg TSS - Final Effluent mg/L	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	2.50	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00	< 2.00		< 2.04	< 2.50	15.00
Eff: # of samples of TSS - Final Effluent	2.00	2.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	2.00	2.00	2.00	26.00			0.00
Loading: TSS - Final Effluent kg/d	< 2.823	< 1.853	< 5.522	< 4.330	< 2.277	2.118	< 1.395	< 1.255	< 1.382	< 1.391	< 2.347	< 2.635		< 2.46	< 5.52	28.770
Percent Removal: TSS - Raw Sewage %	95.12	98.82	98.25	98.63	96.64	95.90	98.89	98.65	98.47	97.26	95.35	95.60		97.30	98.89	0.00
Total Phosphorus: TP																
Raw: Avg TP - Raw Sewage mg/L	0.85	2.00	1.63	0.70	0.79	1.30	3.13	2.47	2.01	1.52	0.72	0.66		1.51	3.13	0.00
Raw: # of samples of TP - Raw Sewage	2.00	2.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	2.00	2.00	2.00	26.00			0.00
Eff: Avg TP - Final Effluent mg/L	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	0.06	0.16	0.14	0.08	0.06	< 0.03	< 0.03		< 0.06	< 0.16	0.25
Eff: # of samples of TP - Final Effluent	2.00	2.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	2.00	2.00	2.00	26.00			0.00

Loading: TP - Final Effluent kg/d	<	0.042	<	0.028	<	0.083	<	0.065	<	0.034		0.047		0.108		0.088		0.058		0.042	<	0.035	<	0.040		<	0.07	<	0.11		0.480
Percent Removal: TP - Raw Sewage %		96.47		98.50		98.16		95.68		96.18		95.77		95.04		94.32		95.85		96.05		95.83		95.45			96.11		98.50		0.00
Nitrogen Series																															
Raw: Avg TKN - Raw Sewage mg/L		11.05		17.55		12.53		9.40		14.50		17.35		27.65		25.30		20.37		21.20		14.70		11.85			16.92		27.65		0.00
Raw: # of samples of TKN - Raw Sewage		2.00		2.00		3.00		2.00		2.00		2.00		2.00		2.00		3.00		2.00		2.00		2.00		26.00					0.00
Eff: Avg TAN - Final Effluent mg/L	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10	<	0.10		<	0.10	<			15.00
Eff: # of samples of TAN - Final Effluent		2.00		2.00		3.00		2.00		2.00		2.00		2.00		2.00		3.00		2.00		2.00		2.00		26.00					0.00
Loading: TAN - Final Effluent kg/d	<	0.141	<	0.093	<	0.276	<	0.217	<	0.114	<	0.085	<	0.070	<	0.063	<	0.069	<	0.070	<	0.117	<	0.132		<	0.12	<	0.28		28.770
Eff: Avg NO3-N - Final Effluent mg/L		12.35		9.85		8.36		9.86		14.70		19.30		21.70		23.75		21.10		19.45		14.25		11.95			15.55		23.75		0.00
Eff: # of samples of NO3-N - Final Effluent		2.00		2.00		3.00		2.00		2.00		2.00		2.00		2.00		3.00		2.00		2.00		2.00		26.00					0.00
Eff: Avg NO2-N - Final Effluent mg/L	<	0.03	<	0.03	<	0.03	<	0.03	<	0.03	<	0.03		0.04		0.04	<	0.03	<	0.04	<	0.03	<	0.03		<	0.03	<	0.04		0.00
Eff: # of samples of NO2-N - Final Effluent		2.00		2.00		3.00		2.00		2.00		2.00		2.00		2.00		3.00		2.00		2.00		2.00		26.00					0.00
Disinfection																															
Eff: GMD E. Coli MPN - Final Effluent MPN		1.00		1.00		1.00		1.00		1.00		1.00		1.00		1.00		1.00		1.00		1.00		1.00							
Eff: # of samples of E. Coli MPN - Final Effluent		4.00		4.00		4.00		5.00		4.00		5.00		4.00		4.00		5.00		4.00		4.00		5.00		52.00					0.00

2025 Annual Performance Report

Appendix B

Calibration Reports



IndusControl Inc
3170 Ridgeway Dr, Unit 11
Mississauga, ON, L5L 5R4

VERIFICATION REPORT ELECTRO-MAGNETIC FLOW MEASUREMENT

Customer Name: Township of Tay
Plant Name: Port McNicoll

Site/Plant Address: 551 FIRST AVENUE
PORT MCNICOLL, ON L0K1R0

Device Information
Make: Fisher-Porter
Model: 50XM13NXAD20AABC22
Order Code: N/A
Serial No.: 4211000201
Tag: FIT7620
Job Location: Raw sewage
Asset Id: 0000350482

Service Information
Date: July 30, 2025
Report No: CO1644-2507-31
Job No: CO1644-2507

Sensor Details
Line size: 8 inch
Model: 10DX3111AAD18P1A3BA1432
Max flow: 1080 m3/hr

Flow Details
Unit: l/sec
Flow Range: N/A
Current Output: 4-20 mA
4 mA Set Point: 0
20 mA Set Point: N/A

Inst. Reading	AS FOUND	AS LEFT
TOTALIZER (m3)	5215232	5215243
FLOW (l/sec)	0.0000	0.0000

Maintenance Checklist	Remarks
Visual Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Electrical Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Sensor Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Transmitter Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	

Instrument Test Information and Results			
Test-Point	Flow Measured on Hand-Held Calibrator (l/sec)	UUT Display (l/sec)	Deviation (l/sec)
1	68.4450	65.8700	-3.91
2	68.7200	66.2200	-3.78
3	70.4560	67.7800	-3.95

Information of Tools used for Verification of the Instruments			
Details	Tool/Kit 1	Tool/Kit 2	Tool/Kit 2
Device Description:	Portable Doppler flow meter	Electrical Multimeter	NA
Manufacturer:	Greyline	Fluke	NA
Model No:	PDFM 5.1	179	NA

* Refer Calibration Tools Certificates submittal for more Information

Overall Test Result: **Passed** **Fail** **Not Verified**

Overall Remarks: Measurement working as per specification

Service Technician : Parth Panchal
Printed Date: July 30, 2025

Stamp/Signature



IndusControl Inc
3170 Ridgeway Dr, Unit 11
Mississauga, ON, L5L 5R4

VERIFICATION REPORT ELECTRO-MAGNETIC FLOW MEASUREMENT

Customer Name: Township of Tay
Plant Name: Port McNicoll

Site/Plant Address: 551 FIRST AVENUE
PORT MCNICOLL, ON L0K1R0

Device Information

Make: Khrone
Model: IFC010F
Order Code: N/A
Serial No.: 450078-2/2
Tag: FIT7520
Job Location: Final sewage
Asset Id: 0000350483

Service Information

Date: July 30, 2025
Report No: CO1644-2507-32
Job No: CO1644-2507

Flow Details

Unit: m3/hr
Flow Range: 0 - 700
Current Output: 4-20 mA
4 mA Set Point: 0
20 mA Set Point: 700

Sensor Details

Line size: 200 mm 8 inch
GKL: 8.4094

Inst. Reading	AS FOUND	AS LEFT
TOTALIZER (m3)	913281	913288
FLOW (m3/hr)	0	0.2

Maintenance Checklist	Remarks
Visual Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK Electrical Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK Sensor Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK Transmitter Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	

Instrument Test Information and Results

Set-Point as Per Calibration KIT	Calculated Flow (m3/hr)	Calculated O/P (mA)	UUT Display (m3/hr)	UUT Measured Output (mA)	Deviation (m3/hr)
0	0.00	4.00	0.03	4.01	-0.03
A	72.47	5.66	72.55	5.68	-0.08
B	144.94	7.31	144.90	7.28	0.04
C	289.89	10.63	289.80	10.61	0.09

Information of Tools used for Verification of the Instruments

Details	Tool/Kit 1	Tool/Kit 2	Tool/Kit 3
Device Description:	Calibrator	Electrical Multimeter	NA
Manufacturer:	Khrone	Fluke	NA
Model No:	GS8B	179	NA

* Refer Calibration Tools Certificates submittal for more Information

Overall Test Result: **Passed** **Fail** **Not Verified**

Overall Remarks: Measurement working as per specification

Service Technician : Parth Panchal
Printed Date: July 30, 2025

Stamp/Signature



IndusControl Inc
3170 Ridgeway Dr, Unit 11
Mississauga, ON, L5L 5R4

VERIFICATION REPORT ELECTRO-MAGNETIC FLOW MEASUREMENT

Customer Name: Township of Tay
Plant Name: Port McNicoll

Site/Plant Address: 551 FIRST AVENUE
PORT MCNICOLL, ON L0K1R0

Device Information
Make: Fisher-Porter
Model: 40DX43
Order Code: N/A
Serial No.: 4587700102
Tag: FIT 3520-1
Job Location: Pearmeate
Asset ID: NA

Service Information
Date: July 30, 2025
Report No: CO1644-2507-33
Job No: CO1644-2507

Sensor Details
Line size: 4 inch

Flow Details
Unit: l/sec
Flow Range: N/A
Current Output: 4-20 mA
4 mA Set Point: N/A
20 mA Set Point: N/A

Inst. Reading	AS FOUND	AS LEFT
TOTALIZER (gal)	1742441	1743416
FLOW (l/sec)	0	10.95

Maintenance Checklist	Remarks
Visual Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Electrical Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Sensor Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Transmitter Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	

Instrument Test Information and Results			
Test-Point	Flow Measured on Hand-Held Calibrator (l/sec)	UUT Display (l/sec)	Deviation (%)
1	10.43	10.85	3.87
2	10.02	10.38	3.47
3	9.66	10.01	3.50

Information of Tools used for Verification of the Instruments			
Details	Tool/Kit 1	Tool/Kit 2	Tool/Kit 2
Device Description:	Portable Doppler flow meter	Electrical Multimeter	NA
Manufacturer:	Greyline	Fluke	NA
Model No:	PDFM 5.1	179	NA

* Refer Calibration Tools Certificates submittal for more Information

Overall Test Result: **Passed** **Fail** **Not Verified**

Overall Remarks: Measurement working as per specification

Service Technician : Parth Panchal
Printed Date: July 30, 2025

Stamp/Signature



IndusControl Inc
3170 Ridgeway Dr, Unit 11
Mississauga, ON, L5L 5R4

VERIFICATION REPORT ELECTRO-MAGNETIC FLOW MEASUREMENT

Customer Name: Township of Tay
Plant Name: Port McNicoll

Site/Plant Address: 551 FIRST AVENUE
PORT MCNICOLL, ON L0K1R0

Device Information
Make: Fisher-Porter
Model: 40DX43
Order Code: N/A
Serial No.: 4587700101
Tag: FIT 3520-2
Job Location: Pearmeate
Asset ID: NA

Service Information
Date: July 30, 2025
Report No: CO1644-2507-34
Job No: CO1644-2507

Sensor Details
Line size: 4 inch

Flow Details
Unit: l/sec
Flow Range: N/A
Current Output: 4-20 mA
4 mA Set Point: N/A
20 mA Set Point: N/A

Inst. Reading	AS FOUND	AS LEFT
TOTALIZER (gal)	33246	33657
FLOW (l/sec)	15.19	15.24

Maintenance Checklist	Remarks
Visual Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Electrical Inspection: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Sensor Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	
Transmitter Installation: <input checked="" type="checkbox"/> OK <input type="checkbox"/> NOT OK	

Instrument Test Information and Results			
Test-Point	Flow Measured on Hand-Held Calibrator (l/sec)	UUT Display (l/sec)	Deviation (l/sec)
1	14.72	15.26	3.54
2	14.76	15.28	3.40
3	14.86	15.45	3.82

Information of Tools used for Verification of the Instruments			
Details	Tool/Kit 1	Tool/Kit 2	Tool/Kit 2
Device Description:	Portable Doppler flow meter	Electrical Multimeter	NA
Manufacturer:	Greyline	Fluke	NA
Model No:	PDFM 5.1	179	NA

* Refer Calibration Tools Certificates submittal for more Information

Overall Test Result: **Passed** **Fail** **Not Verified**

Overall Remarks: Measurement working as per specification


Service Technician : Parth Panchal
Printed Date: July 30, 2025

Stamp/Signature



IndusControl Inc
3170 Ridgeway Drive Unit 11
Mississauga, ON, L5L 5R4

PORTABLE pH METER VERIFICATION / CALIBRATION REPORT

Customer Name:	Township of Tay		Address	150 INDUSTRIAL ROAD, VICTORIA HARBOUR, ON L0K2A0		
Plant Name:	Victoria Harbour WWTP					
Location:	Victoria Harbour WWTP		Date	July 24, 2025		
Tag:	0000350064		Report No	CO1643-2507-12		
Device Discription:	Lab pH Analyzer		Job No	CO1643-2507		
Device Information		pH Sensor Information		pH Sensor Information		
Instrument Make:	Hach		Sensor Make:	Hach	Sensor Make:	Hach
Model/Part No:	HQ40d		Model/Part No:	PHC101	Model/Part No:	LD0101
Serial No:	150900015832		Serial No:	251542561187	Serial No:	152612597018
pH Calibration Test Details						
Standard Solution	Calculated Value(pH)	UUT Display(pH)	UUT Display(mV)	Temp(Celcius)	Test Result	
pH 4.0	4.00	4.01	170.1	27.0	Passed	
pH 7.0	7.00	7.00	-0.70	26.5	Passed	
pH 10.0	10.00	10.01	-174.70	26.6	Passed	
pH after calibration	Slope	-57.22 mV/pH		Offset	-1.4 mV	
DO after calibration	Slope	100%		Offset	0.00 mg\lL	
Overall Test Result:	<input checked="" type="checkbox"/> Passed		<input type="checkbox"/> Fail		<input type="checkbox"/> Not Verified	
Notes:	Device is working as per Specification. Calibration Test Passed.					
Service Technician :	Parth Panchal		Stamp/Signature			
Printed Date:	July 24, 2025					
End of Report			Version: 20-01			



IndusControl Inc
3170 Ridgeway Drive Unit 11
Mississauga, ON, L5L 5R4

PORTABLE SPECTROPHOTOMETER
VERIFICATION REPORT

Customer Name	Township of Tay	Address	150 INDUSTRIAL ROAD, VICTORIA HARBOUR, ON L0K2A0
Plant Name	Victoria Harbour WWTP		
Location	Victoria Harbour WWTP	Date	July 24, 2025
Tag:	0000350065	Report No	CO1643-2507-13
Device Discription	Spectrophotometer	Job No	CO1643-2507

Device Information

Instrument Make:	HACH
Model/Part No:	DR/2800
Serial No:	1228461

Verification / Calibration Test Details

Test Method	Test Filter	Nominal Value	Actual Value	Test Result
Stray Light Check	KV450/3	>2.8 Abs	4.567 Abs	Passed
Photometrical Accuracy	NG9/1	1.568 Abs	1.584 Abs	Passed
	NG5/2	0.628 Abs	0.633 Abs	Passed
	NG11/2	0.316 Abs	0.330 Abs	Passed
Wavelength Accuracy	Ho	358.0-364.0 nm	360.8 nm	Passed
	BG20/2	804.0-810.0 nm	807.3 nm	Passed

Overall Test Result:	<input checked="" type="checkbox"/> Passed	<input type="checkbox"/> Fail	<input type="checkbox"/> Not Verified
----------------------	--	-------------------------------	---------------------------------------

Notes: Device working as per specification. Wavelength Accuracy Test Passed.

Service Technician :	Parth Panchal	Stamp/Signature	
Printed Date:	January 0, 1900		


End of Report

Version: 20-01



IndusControl Inc
3170 Ridgeway Drive Unit 11
Mississauga, ON, L5L 5R4

PORTABLE pH METER VERIFICATION / CALIBRATION REPORT

Customer Name:	Township of Tay	Address	150 INDUSTRIAL ROAD, VICTORIA HARBOUR, ON L0K2A0		
Plant Name:	Victoria Harbour WWTP				
Location:	Victoria Harbour WWTP	Date	July 24, 2025		
Tag:	0000359767	Report No	CO1643-2507-14		
Device Discription:	Lab pH Analyzer	Job No	CO1643-2507		
Device Information			pH Sensor Information		
Instrument Make:	Hach	Sensor Make:	Hach		
Model/Part No:	HQ1110	Model/Part No:	PHC101		
Serial No:	241851110002	Serial No:	251542561169		
pH Calibration Test Details					
Standard Solution	Calculated Value(pH)	UUT Display(pH)	UUT Display(mV)	Temp(Celcius)	Test Result
pH 4.0	4.00	4.01	174.4	27.2	Passed
pH 7.0	7.00	7.00	-1.50	26.7	Passed
pH 10.0	10.00	10.01	-176.50	26.9	Passed
pH after calibration	Slope	98%		Offset	-1.3 mV
Overall Test Result:	<input checked="" type="checkbox"/> Passed		<input type="checkbox"/> Fail		<input type="checkbox"/> Not Verified
Notes:	Device is working as per Specification. Calibration Test Passed.				
Service Technician :	Parth Panchal	Stamp/Signature			
Printed Date:	July 24, 2025				
End of Report			Version: 20-01		

2025 Performance Assessment Report

Appendix C

Biosolids Quantity and Haulage Records

Deliveries From Port McNicoll To Farm Fields								
Delivered	Ticket	NASM	Field	Drvr	Trck	Trlr	#Loads	Volume In M ³
15 Aug,2025	84097	24872	Home/Far Side-Field:FAR SIDE	300	T071	TT084	2	84.00
15 Aug,2025	84809	24872	Home/Far Side-Field:FAR SIDE	342	T089	TT100	2	84.00
18 Aug,2025	80115	24872	Home/Far Side-Field:FAR SIDE	317	T060	TT102	3	126.00
18 Aug,2025	84132	24872	Home/Far Side-Field:FAR SIDE	270	T081	TT099	3	126.00
18 Aug,2025	84812	24872	Home/Far Side-Field:FAR SIDE	342	T089	TT100	3	126.00
Totals for August:							13	546.00
16 Oct,2025	84971	62622	Rowe-Field:1	61	T082	TT089	2	84.00
16 Oct,2025	87730	62622	Rowe-Field:1	336	T080	TT101	3	126.00
Totals To October:							5	210.00
Totals To NASM #24872, Farm 'Home/Far Side', Field 'FAR SIDE':							13	546.00
Totals To NASM #62622, Farm 'Rowe', Field '1':							5	210.00
Grand Totals:							18	756.00

Deliveries From Port McNicoll To Other Locations							
Delivered	Ticket	To	Drvr	Trck	Trlr	#Loads	Volume In M ³
25 Apr,2025	82116	Rohes 4 Lagoon	61	T082	TT089	2	84.00
28 Apr,2025	82120	Rohes 4 Lagoon	61	T082	TT089	2	84.00
29 Apr,2025	83683	Rohes 4 Lagoon	61	T082	TT089	4	168.00
30 Apr,2025	83685	Rohes 4 Lagoon	61	T082	TT089	3	126.00
Totals for April:						11	462.00
05 May,2025	86104	Rohes 4 Lagoon	270	T081	TT099	3	126.00
Totals for May:						3	126.00
Totals To Rohes 4 Lagoon:						14	588.00
Grand Totals:						14	588.00

2025 Annual Performance Report

Appendix D

Biosolids Quality Data

Solids & Nutrients

Period: 01/01/2025 to 12/31/2025

Works: 1676 / Digester Type: Anaerobic

Solids & Nutrients	Metals & Criteria	Last 4 Samples
-------------------------------	------------------------------	-----------------------

Facility Works Number:	110001417	Receiver:	Hoggs Bay
Facility Owner:	Municipality: Township of Tay	Service Population:	1856
Facility Classification:	Class 2 Wastewater Treatment	Total Design Capacity:	7776 m3/day

Note: all parameters in this report are derived from the Bslq Station

Month	Hauled Vol. (m³)	Total Solids (mg/L)	Volatile Solids (mg/L)	Total Phosphorus (mg/L)	Total Ammonia Nitrogen (mg/L)	Nitrate as N (mg/L)	Nitrite as N (mg/L)	Total Kjeldahl Nitrogen (mg/L)	Ammonia + Nitrate (mg/L)	Potassium (mg/L)
Parameter Short Name	HauledVol	TS	VS	TP	NH3p_NH4p_N	NO3-N	NO2-N	TKN	Calculation in Report	K
T/S	IH Month.Total	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	- no T/S	Lab Published Month Mean
Jan		36,300.00	24,500.00	1,200.00	5.10	25.00	3.00	1,510.00	15.05	125.00
Feb		20,100.00	14,800.00	473.00	5.60	3.00	3.00	1,120.00	4.30	55.90
Mar		14,800.00	11,800.00	426.00	4.00	3.00	3.00	815.00	3.50	58.10
Apr	462.00	25,000.00	17,600.00	715.00	8.00	10.00	3.00	1,480.00	9.00	103.00
May		7,620.00	5,190.00	173.00	20.90	3.00	3.00	450.00	11.95	45.00
Jun		28,700.00	19,300.00	714.00	33.90	11.00	3.00	1,570.00	22.45	76.00
Jul		25,500.00	16,300.00	640.00	3.50	15.00	3.00	788.00	9.25	66.00
Aug	546.00	25,500.00	18,400.00	613.00	2.40	110.00	3.00	697.00	56.20	71.00
Sep		4,760.00	3,290.00	119.00	5.00	33.00	3.00	200.00	19.00	24.00
Oct	210.00	18,500.00	13,600.00	540.00	3.10	85.00	3.00	886.00	44.05	46.00
Nov		28,600.00	21,000.00	888.00	4.70	27.00	3.00	1,350.00	15.85	71.00
Dec		20,600.00	14,300.00	641.00	1.00	24.00	3.00	1,130.00	12.50	57.00
Average	406.00	21,331.67	15,006.67	595.17	8.10	29.08	3.00	999.67	18.59	66.50
Total	1,218.00	255,980.00	180,080.00	7,142.00	97.20	349.00	36.00	11,996.00	223.10	798.00

Solids & Nutrients

Metals & Criteria

Last 4 Samples

Note: all parameters in this report are derived from the Bslq Station

Month	Arsenic (mg/L)	Cadmium (mg/L)	Cobalt (mg/L)	Chromium (mg/L)	Copper (mg/L)	Mercury (mg/L)	Molybdenum (mg/L)	Nickel (mg/L)	Lead (mg/L)	Selenium (mg/L)	Zinc (mg/L)
Parameter Short Name	As	Cd	Co	Cr	Cu	Hg	Mo	Ni	Pb	Se	Zn
T/S	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean
Jan	0.10	0.02	0.06	0.48	12.10	0.01	0.23	0.68	0.40	0.22	24.10
Feb	0.10	0.01	0.02	0.24	4.69	0.00	0.09	0.29	0.17	0.10	8.80
Mar	0.10	0.01	0.02	0.27	4.09	0.00	0.07	0.21	0.10	0.10	7.32
Apr	0.10	0.01	0.04	0.27	6.90	0.00	0.11	0.38	0.30	0.10	12.00
May	0.10	0.01	0.01	0.07	1.70	0.00	0.05	0.09	0.10	0.10	3.00
Jun	0.10	0.01	0.04	0.29	7.40	0.00	0.11	0.41	0.30	0.10	12.00
Jul	0.10	0.01	0.03	0.25	6.20	0.00	0.11	0.34	0.30	0.10	11.00
Aug	0.10	0.01	0.03	0.25	5.90	0.00	0.10	0.31	0.20	0.10	10.00
Sep	0.10	0.01	0.01	0.04	1.30	0.00	0.05	0.06	0.10	0.10	2.00
Oct	0.10	0.01	0.03	0.19	5.90	0.00	0.09	0.23	0.20	0.10	9.00
Nov	0.10	0.01	0.04	0.32	10.00	0.00	0.16	0.40	0.30	0.10	15.00
Dec	0.10	0.01	0.03	0.22	6.50	0.00	0.12	0.29	0.30	0.10	11.00
Average	0.10	0.01	0.03	0.24	6.06	0.00	0.11	0.31	0.23	0.11	10.44
Min. Acceptable Ammonia + Nitrate Nitrogen to Metal Ratio	100.00	500.00	50.00	6.00	10.00	1,500.00	180.00	40.00	15.00	500.00	4.00
Ammonia + Nitrate Nitrogen to Metal Ratio in Sludge	188.23	1,694.51	620.54	78.27	3.11	7,058.69	175.00	61.21	81.31	171.51	1.80

Solids & Nutrients

Metals & Criteria

Last 4 Samples

Note: all parameters in this report are derived from the Bslq Station

Parameter Short Name	Time Series	09/02/2025	10/06/2025	11/03/2025	12/01/2025	Average	Metal Concentrations in Sludge (mg/kg)	Max. Permissible Metal Concentrations (mg/kg of Solids)
As (mg/L)	Lab Published	0.10	0.10	0.10	0.10	0.10	5.52	170
Cd (mg/L)	Lab Published	0.01	0.01	0.01	0.01	0.01	0.55	34
Co (mg/L)	Lab Published	0.01	0.03	0.04	0.03	0.03	1.52	340
Cr (mg/L)	Lab Published	0.04	0.19	0.32	0.22	0.19	10.63	2800
Cu (mg/L)	Lab Published	1.30	5.90	10.00	6.50	5.93	327.08	1700
Hg (mg/L)	Lab Published	0.00	0.00	0.00	0.00	0.00	0.12	11
Mo (mg/L)	Lab Published	0.05	0.09	0.16	0.12	0.11	5.80	94
Ni (mg/L)	Lab Published	0.06	0.23	0.40	0.29	0.25	13.52	420
Pb (mg/L)	Lab Published	0.10	0.20	0.30	0.30	0.23	12.42	1100
Se (mg/L)	Lab Published	0.10	0.10	0.10	0.10	0.10	5.52	34
Zn (mg/L)	Lab Published	2.00	9.00	15.00	11.00	9.25	510.63	4200
E.Coli Dry Wt (cfu/g)	Lab Published						E. Coli average is the GMD	
TS (mg/L)	Lab Published	4,760.00	18,500.00	28,600.00	20,600.00	18,115.00		
VS (mg/L)	Lab Published	3,290.00	13,600.00	21,000.00	14,300.00	13,047.50		
TP (mg/L)	Lab Published	119.00	540.00	888.00	641.00	547.00		
NO2-N (mg/L)	Lab Published	3.00	3.00	3.00	3.00	3.00		
TKN (mg/L)	Lab Published	200.00	886.00	1,350.00	1,130.00	891.50		
K (mg/L)	Lab Published	24.00	46.00	71.00	57.00	49.50		
NH3p_NH4p_N (mg/L)	Lab Published	5.00	3.10	4.70	1.00	3.45		
NO3-N (mg/L)	Lab Published	33.00	85.00	27.00	24.00	42.25		

Solids & Nutrients

Period: 01/01/2025 to 12/31/2025

Works: 1676 / Digester Type: Aerobic

Solids & Nutrients	Metals & Criteria	Last 4 Samples
-------------------------------	------------------------------	-----------------------

Facility Works Number: 110001417	Receiver: Hoggs Bay
Facility Owner: Municipality: Township of Tay	Service Population: 1856
Facility Classification: Class 2 Wastewater Treatment	Total Design Capacity: 7776 m3/day

Note: all parameters in this report are derived from the Bslq Station

Month	Hauled Vol. (m³)	Total Solids (mg/L)	Volatile Solids (mg/L)	Total Phosphorus (mg/L)	Total Ammonia Nitrogen (mg/L)	Nitrate as N (mg/L)	Nitrite as N (mg/L)	Total Kjeldahl Nitrogen (mg/L)	Ammonia + Nitrate (mg/L)	Potassium (mg/L)
Parameter Short Name	HauledVol	TS	VS	TP	NH3p_NH4p_N	NO3-N	NO2-N	TKN	Calculation in Report	K
T/S	IH Month.Total	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	- no T/S	Lab Published Month Mean
Jan		36,300.00	24,500.00	1,200.00	5.10	25.00	3.00	1,510.00	15.05	125.00
Feb		20,100.00	14,800.00	473.00	5.60	3.00	3.00	1,120.00	4.30	55.90
Mar		14,800.00	11,800.00	426.00	4.00	3.00	3.00	815.00	3.50	58.10
Apr	462.00	25,000.00	17,600.00	715.00	8.00	10.00	3.00	1,480.00	9.00	103.00
May		7,620.00	5,190.00	173.00	20.90	3.00	3.00	450.00	11.95	45.00
Jun		28,700.00	19,300.00	714.00	33.90	11.00	3.00	1,570.00	22.45	76.00
Jul		25,500.00	16,300.00	640.00	3.50	15.00	3.00	788.00	9.25	66.00
Aug	546.00	25,500.00	18,400.00	613.00	2.40	110.00	3.00	697.00	56.20	71.00
Sep		4,760.00	3,290.00	119.00	5.00	33.00	3.00	200.00	19.00	24.00
Oct	210.00	18,500.00	13,600.00	540.00	3.10	85.00	3.00	886.00	44.05	46.00
Nov		28,600.00	21,000.00	888.00	4.70	27.00	3.00	1,350.00	15.85	71.00
Dec		20,600.00	14,300.00	641.00	1.00	24.00	3.00	1,130.00	12.50	57.00
Average	406.00	21,331.67	15,006.67	595.17	8.10	29.08	3.00	999.67	18.59	66.50
Total	1,218.00	255,980.00	180,080.00	7,142.00	97.20	349.00	36.00	11,996.00	223.10	798.00

Solids & Nutrients

Metals & Criteria

Last 4 Samples

Note: all parameters in this report are derived from the Bslq Station

Month	Arsenic (mg/L)	Cadmium (mg/L)	Cobalt (mg/L)	Chromium (mg/L)	Copper (mg/L)	Mercury (mg/L)	Molybdenum (mg/L)	Nickel (mg/L)	Lead (mg/L)	Selenium (mg/L)	Zinc (mg/L)
Parameter Short Name	As	Cd	Co	Cr	Cu	Hg	Mo	Ni	Pb	Se	Zn
T/S	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean	Lab Published Month Mean
Jan	0.10	0.02	0.06	0.48	12.10	0.01	0.23	0.68	0.40	0.22	24.10
Feb	0.10	0.01	0.02	0.24	4.69	0.00	0.09	0.29	0.17	0.10	8.80
Mar	0.10	0.01	0.02	0.27	4.09	0.00	0.07	0.21	0.10	0.10	7.32
Apr	0.10	0.01	0.04	0.27	6.90	0.00	0.11	0.38	0.30	0.10	12.00
May	0.10	0.01	0.01	0.07	1.70	0.00	0.05	0.09	0.10	0.10	3.00
Jun	0.10	0.01	0.04	0.29	7.40	0.00	0.11	0.41	0.30	0.10	12.00
Jul	0.10	0.01	0.03	0.25	6.20	0.00	0.11	0.34	0.30	0.10	11.00
Aug	0.10	0.01	0.03	0.25	5.90	0.00	0.10	0.31	0.20	0.10	10.00
Sep	0.10	0.01	0.01	0.04	1.30	0.00	0.05	0.06	0.10	0.10	2.00
Oct	0.10	0.01	0.03	0.19	5.90	0.00	0.09	0.23	0.20	0.10	9.00
Nov	0.10	0.01	0.04	0.32	10.00	0.00	0.16	0.40	0.30	0.10	15.00
Dec	0.10	0.01	0.03	0.22	6.50	0.00	0.12	0.29	0.30	0.10	11.00
Average	0.10	0.01	0.03	0.24	6.06	0.00	0.11	0.31	0.23	0.11	10.44
Max. Permissible Metal Concentrations (mg/kg of Solids)	170.00	34.00	340.00	2,800.00	1,700.00	11.00	94.00	420.00	1,100.00	34.00	4,200.00
Metal Concentrations in Sludge (mg/kg)	4.69	0.52	1.42	11.27	283.93	0.13	5.04	14.42	10.85	5.14	489.18

Solids & Nutrients

Metals & Criteria

Last 4 Samples

Note: all parameters in this report are derived from the Bslq Station

Parameter Short Name	Time Series	09/02/2025	10/06/2025	11/03/2025	12/01/2025	Average	Metal Concentrations in Sludge (mg/kg)	Max. Permissible Metal Concentrations (mg/kg of Solids)
As (mg/L)	Lab Published	0.10	0.10	0.10	0.10	0.10	5.52	170
Cd (mg/L)	Lab Published	0.01	0.01	0.01	0.01	0.01	0.55	34
Co (mg/L)	Lab Published	0.01	0.03	0.04	0.03	0.03	1.52	340
Cr (mg/L)	Lab Published	0.04	0.19	0.32	0.22	0.19	10.63	2800
Cu (mg/L)	Lab Published	1.30	5.90	10.00	6.50	5.93	327.08	1700
Hg (mg/L)	Lab Published	0.00	0.00	0.00	0.00	0.00	0.12	11
Mo (mg/L)	Lab Published	0.05	0.09	0.16	0.12	0.11	5.80	94
Ni (mg/L)	Lab Published	0.06	0.23	0.40	0.29	0.25	13.52	420
Pb (mg/L)	Lab Published	0.10	0.20	0.30	0.30	0.23	12.42	1100
Se (mg/L)	Lab Published	0.10	0.10	0.10	0.10	0.10	5.52	34
Zn (mg/L)	Lab Published	2.00	9.00	15.00	11.00	9.25	510.63	4200
E.Coli Dry Wt (cfu/g)	Lab Published						E. Coli average is the GMD	
TS (mg/L)	Lab Published	4,760.00	18,500.00	28,600.00	20,600.00	18,115.00		
VS (mg/L)	Lab Published	3,290.00	13,600.00	21,000.00	14,300.00	13,047.50		
TP (mg/L)	Lab Published	119.00	540.00	888.00	641.00	547.00		
NO2-N (mg/L)	Lab Published	3.00	3.00	3.00	3.00	3.00		
TKN (mg/L)	Lab Published	200.00	886.00	1,350.00	1,130.00	891.50		
K (mg/L)	Lab Published	24.00	46.00	71.00	57.00	49.50		
NH3p_NH4p_N (mg/L)	Lab Published	5.00	3.10	4.70	1.00	3.45		
NO3-N (mg/L)	Lab Published	33.00	85.00	27.00	24.00	42.25		